


BASIN ASSEMBLY TOP VIEW

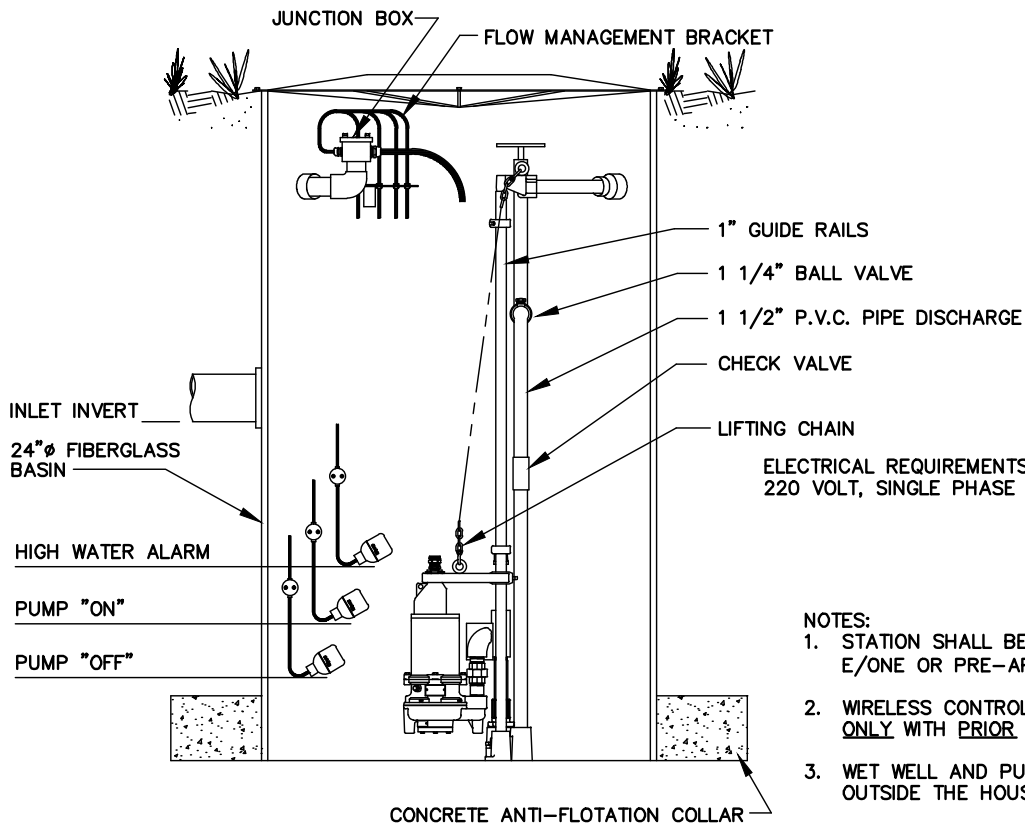

BASIN ASSEMBLY SIDE VIEW

**PRESSURE SEWER GRINDER
PUMP STATION DETAIL**

NOT TO SCALE

NOTES:

1. STATION SHALL BE MANUFACTURED BY E/ONE OR PRE-APPROVED EQUAL.
2. WIRELESS CONTROLS MAY BE UTILIZED ONLY WITH PRIOR AUTHORITY APPROVAL.
3. WET WELL AND PUMP MUST BE INSTALLED OUTSIDE THE HOUSE.
4. INSTALL ELECTRIC DISCONNECT ON OUTSIDE OF HOUSE.

REVISED 11/4/14

PRESSURE SEWER GRINDER PUMP STATION

PREPARED FOR:

PERKASIE REGIONAL AUTHORITY



ANDERSEN
ENGINEERING
ASSOCIATES
INCORPORATED
306 NORTH FIFTH STREET, PERKASIE, PA
(215) 257-5711

DSN BY:	P.C.A.
CHK BY:	P.C.A.
DATE:	4/09/97
DWG NO.	PRA-S016