



M:\Authority clients\PERKASIE\Water Details\All PRA Water Details 2015.dwg, Model, 10/22/2015 2:38:10 PM, Tinac

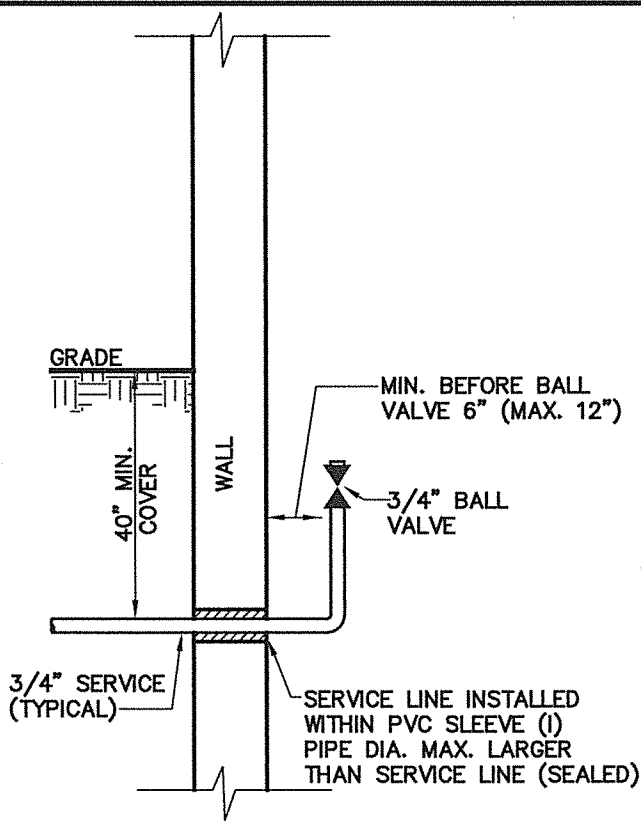

BASEMENT SERVICE

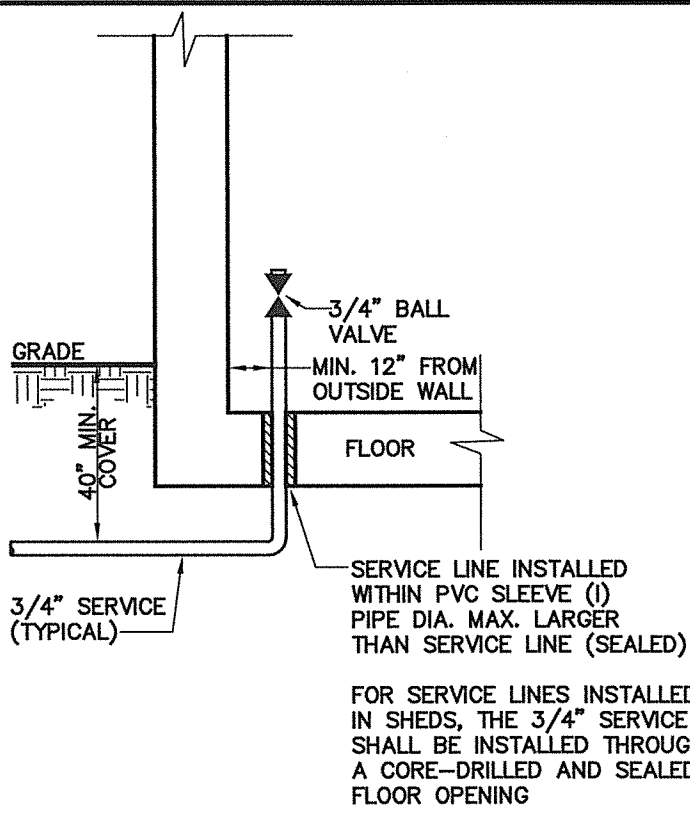


THROUGH FLOOR SERVICE

GENERAL NOTES:

1. NOTIFY AUTHORITY AT 215-257-3654 WHEN WATER SERVICE IS READY FOR INSPECTION AND TESTING. DO NOT BACKFILL ANY PORTION OF TRENCH PRIOR TO APPROVAL. 24 HOURS NOTICE REQUIRED.
2. WATER AUTHORITY WILL SUPPLY 5/8"x5/8" SR BRONZE REMOTE TYPE METER AND REMOTE METER READING.
3. PRESSURE REDUCING VALVE IS REQUIRED WHERE PRESSURE IS GREATER THAN 65 PSI. OWNER/DEVELOPER SHALL PROVIDE THE PRESSURE REDUCING VALVE.
4. METER LOCATION MUST BE APPROVED BY THE AUTHORITY.
5. ALL SERVICE LINES ARE TO BE K-TYPE TUBING ONLY WITH NO SWEAT JOINTS OR COUPLINGS UNDERGROUND.
- *6. WATTS NUMBER 007 (LEAD FREE) BACKFLOW PREVENTOR SHALL BE PROVIDED BY THE OWNER/DEVELOPER WHEN REQUIRED BY PRA.

**7. PRESSURE REDUCER VALVE TO BE WATTS UB5 - LEAD FREE

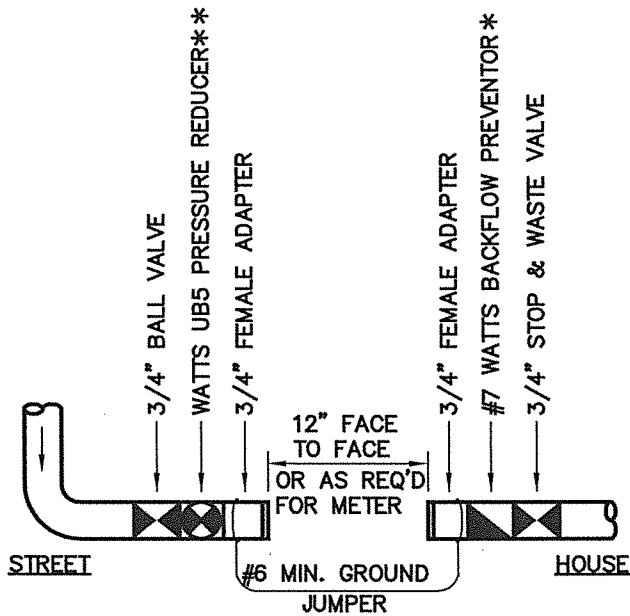

FRONT VIEW OF SETTING

RESIDENTIAL METER SETTING REQUIREMENTS

NOT TO SCALE

REVISED 10/22/15
 REVISED 7/4/12
 REVISED 4/30/08

RESIDENTIAL METER SETTING REQUIREMENTS

PREPARED FOR:

PERKASIE REGIONAL AUTHORITY

ANDERSEN
ENGINEERING
ASSOCIATES
INCORPORATED
 306 NORTH FIFTH STREET, PERKASIE, PA
 (215) 257-3711

DSN BY:	P.C.A.
CHK BY:	P.C.A.
DATE:	4/08/96
DWG NO.	PRA-W10